



**Siemens,** Model # SUAS877-PG (or Landis & Gyr # UAS877-PG)



Midwest

UTRS223AMEP



Eaton-Durham Model # UTRS223ACH



Milbank


Model # U1980-O


These are some examples of the single meter sockets we require for underground service. Our cable comes in on the bottom and goes straight into the terminal lugs. No Wire Bending Required.


Socket/Breaker combination panels with this design are also acceptable and shown on our web-page under "Meters".


Effective June, 2008

Revised April, 2013

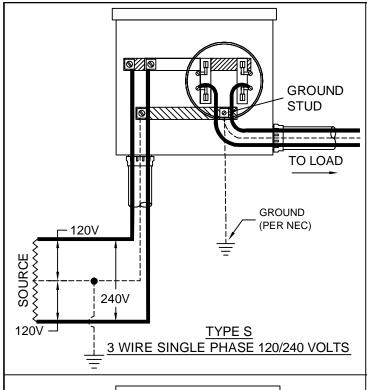

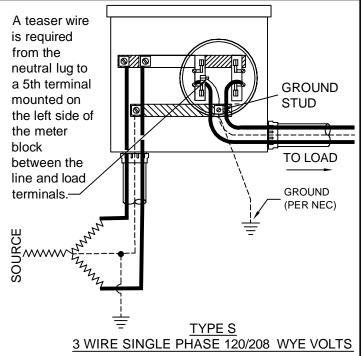


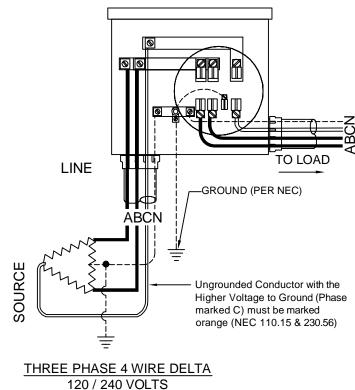

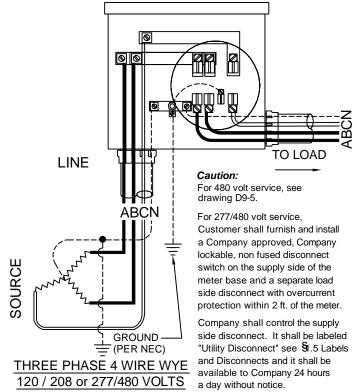

## Notes:

- 1. All diagrams on this drawing show connections when the switch is installed on the right side (see Right Side below) of the meter socket. If the switch is installed on the left side of the meter socket you will need to mirror this diagram (see Left Side below).
- 2. All sockets, except residential single phase less than 320 Amps, shall have a manual mechanical gang operated bypass switch.
- 3. Load and supply wires shall not cross in the meter socket.

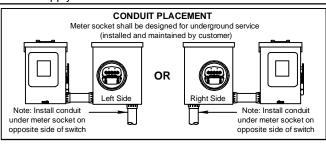

		meter socket on LJ LJ site side of switch	opposite side of switc		
1	01/13	REVISION OF DRAWING SS11.8-2		EJH	
NO.	DATE:	REVISION		BY:	APPR:

## ENTERGY SERVICES, INC. WIRING DIAGRAM CONNECTIONS FOR UNDERGROUND SELF CONTAINED METERS

 APPROVED BY:
 JRH
 DATE:
 01/10/2013

 CHECKED BY:
 JED
 SCALE:
 NONE

 DRAWN BY:
 krich95

	No.				
**Entergy	PLOT	1=1	SH.	2 OF	2